



HARTLEPOOL
BOROUGH COUNCIL
OFFICER DECISION RECORD

Department: Development, N/hoods and Regulatory Servs

Division:

Date of Decision / Issue of Licence: 03/04/2024

Officer Making Decision: MR T HANSON

Subject / Description & Reason for Decision:
(for publication) Cable Easement – Old Cemetery Road

This Council has been approached by Northern Powergrid, who are looking to install an underground cable.

Terms for easement to allow the apparatus to be installed have been provisionally agreed.

Type of Decision: Non Key

Nature of Delegation Being Exercised: Delegated Authority, EDDNRS223

Alternative Options Considered & Rejected: Not to grant the easement


Any Declared Register of Interest: No

OFFICER WITH THE DELEGATION

NAME: MR T HANSON
POSITION: Executive Director Dev N/hood & Reg Serv

IN CONSULTATION WITH...

NAME: TONY HANSON
POSITION: Executive Director Dev N/hood & Reg Serv

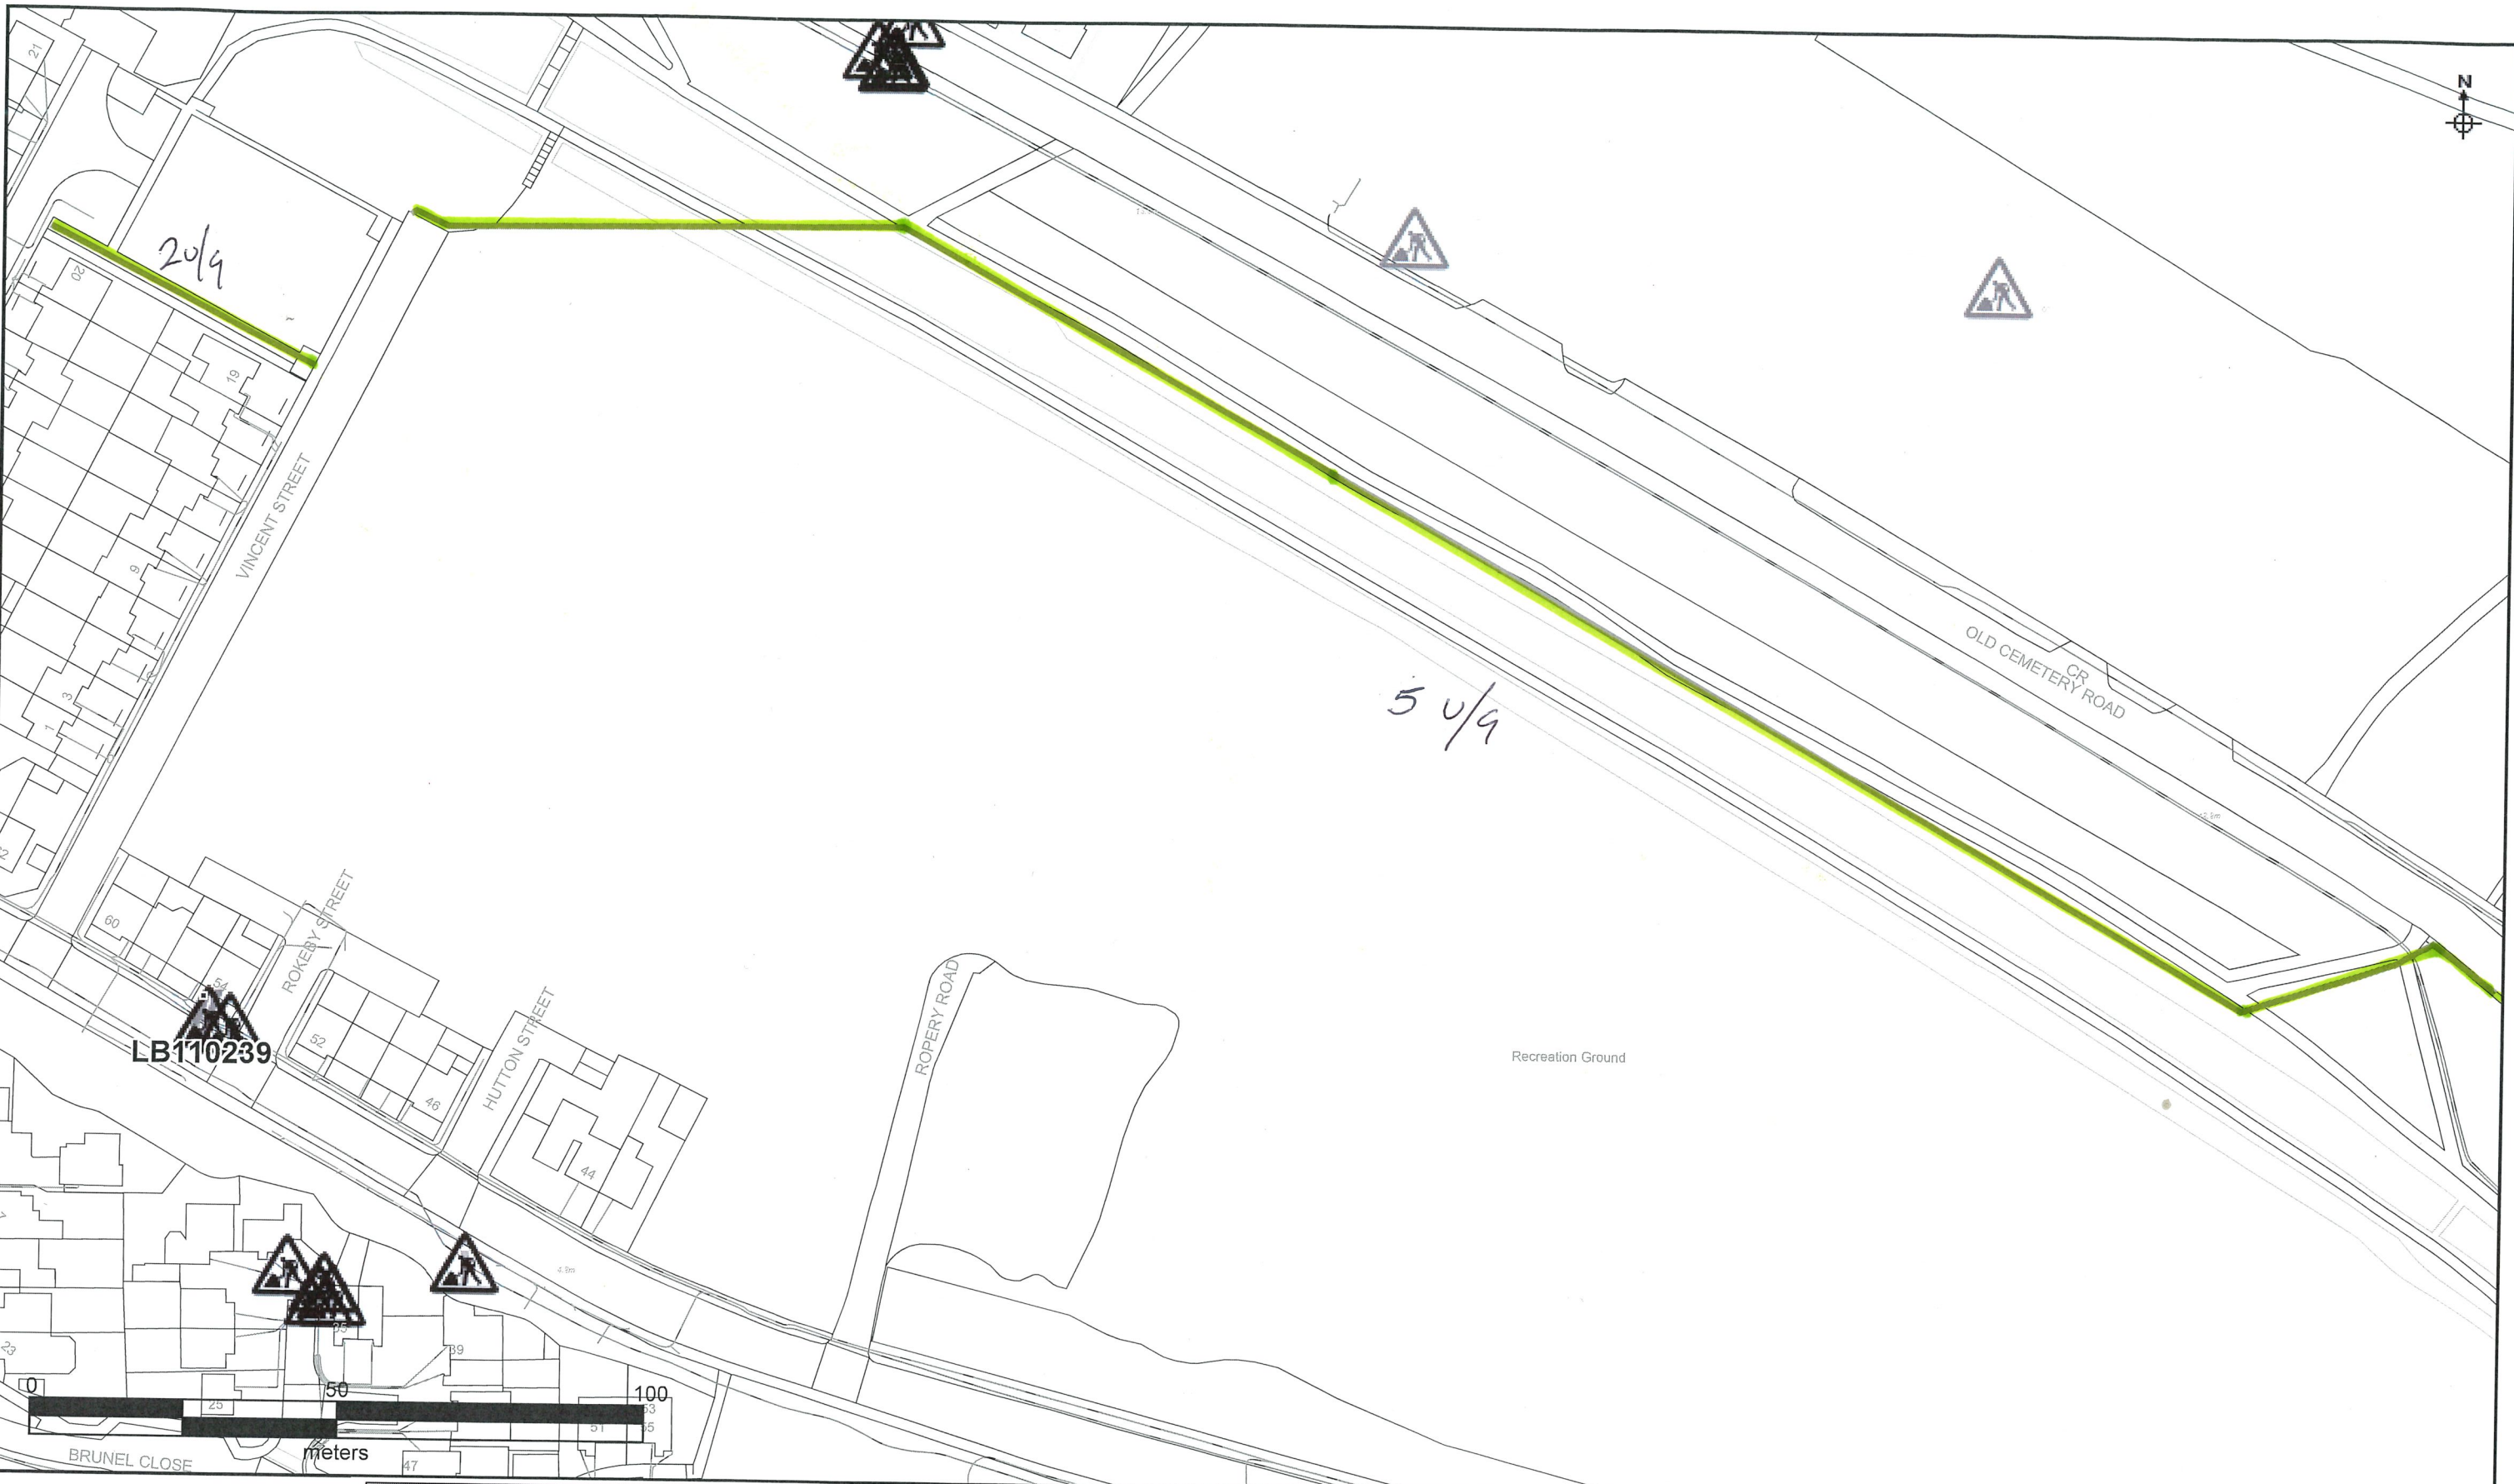

LB110239

50/9

Northern Powergrid Holdings Company
 The position of our equipment is shown on the plan as accurately as possible, it may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electricity cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance:
HSG47 Avoiding Danger from Underground Services and **GS6 Avoiding Danger from Overhead Power Lines**

© Northern Powergrid Holdings Company 2024. This document, and its contents, are for your sole use only. You must not use the contents of this document for any other purpose. You must not incorporate the contents of this document into your ownworks or use such contents for any other commercial purposes. You must seek our prior written consent before sharing the contents of this document with any third party.

© Crown Copyright and database rights 2024. (Northern Powergrid Holdings Company, 100022432).
 Reproduced from or based upon the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey on behalf of the Controller of His Majesty's Stationary Office.

Warning - Work in progress in this area		
Underground Cables:		
132kV	20kV	LV Mains
66kV	11kV	LV Service
33kV	6kV	LV Service Assumed Route
25kV	3kV	LV Service Logical Connection
Left In Situ	Aux	Duct
Overhead Conductors:		
132kV	20kV	LV Mains
66kV	11kV	LV Service
33kV	6kV	Aux
25kV	3kV	
Original Print Size A3		
Date Printed: 8 Mar 2024		Scale: 1:1000

OS Grid Reference: NZ5153134573
 Printed By: richard.lawson
 Title:

